

ICC Evaluation Service, Inc.
www.icc-es.org

Business/Regional Office ■ 5360 Workman Mill Road, Whittier, California 90601 ■ (562) 699-0543
Regional Office ■ 900 Montclair Road, Suite A, Birmingham, Alabama 35213 ■ (205) 599-9800
Regional Office ■ 4051 West Flossmoor Road, Country Club Hills, Illinois 60478 ■ (708) 799-2305

DIVISION: 09—FINISHES
Section: 09220—Portland Cement Plaster

REPORT HOLDER:

CTS CEMENT MANUFACTURING COMPANY
11065 KNOTT AVENUE, SUITE A
CYPRESS, CALIFORNIA 90630
(714) 379-8260
www.ctscement.com
rapioiset@ctscement.com

EVALUATION SUBJECT:

RAPID SET ONE COAT STUCCO SYSTEM

1.0 EVALUATION SCOPE

Compliance with the following codes:

- 2006 *International Building Code*® (IBC)
- 2006 *International Residential Code*® (IRC)
- Other Codes (see Section 8.0)

Properties evaluated:

- Structural
- Durability
- Fire-resistance-rated construction
- Noncombustible construction

2.0 USES

The Rapid Set One Coat Stucco System is an exterior wall covering for installation on exterior walls of wood or steel framed construction, or masonry or concrete construction.

3.0 DESCRIPTION

3.1 General:

The Rapid Set One Coat Stucco System includes Rapid Set stucco, an exterior cementitious coating reinforced with wire fabric or metal lath and applied over substrates of fiberboard, plywood, or gypsum sheathing on wood or steel framed walls, or applied directly to masonry or concrete construction without the wire fabric or metal lath.

3.2 Materials:

3.2.1 Rapid Set Stucco: Rapid Set Stucco is a factory-prepackaged mixture of Rapid Set Eisenwall Cement and graded sand, packaged in 55-pound (25 kg) bags. Each bag of Rapid Set Stucco is jobsite-mixed with approximately 3½ quarts (3.3 L) of water in accordance with the manufacturer's recommendations.

As an alternate, the Rapid Set Stucco may also be a jobsite mixture of 88-pound (40 kg) bags of Rapid Set Eisenwall

Cement mixed with approximately 3 gallons (11.3 L) of water and 3 to 4 cubic feet (0.085 to 0.115 m³) of graded sand complying with Section 3.2.3 of this report, the whole mixed in accordance with the manufacturer's instructions.

3.2.2 Rapid Set Eisenwall Cement: The Rapid Set Eisenwall Cement is a proprietary cement packaged in 88-pound (40 kg) bags.

3.2.3 Sand: Sand must be clean and free from deleterious amounts of loam, clay, silt, soluble salts and organic matter. Sampling and testing must comply with ASTM C 144. Sand must be graded in accordance with ASTM C 144 within the limits shown in the following table:

RETAINED ON U.S. STANDARD SIEVE	PERCENT RETAINED BY WEIGHT ± 2 PERCENT	
	Minimum	Maximum
No. 4 (7.6 mm)	—	0
No. 8 (2.4 mm)	0	10
No. 16 (1.2 mm)	10	40
No. 30 (600 µm)	30	65
No. 50 (300 µm)	70	90
No. 100 (150 µm)	95	100

3.2.4 Lath: Wire fabric lath and metal lath must comply with the requirements of the applicable code for three-coat exterior plaster. Lath must be self-furred or furred when applied over all supports and substrates.

3.2.5 Wood Structural Panel Sheathing: Minimum 5/16-inch-thick (7.9 mm) plywood panels for studs spaced 16 inches on center (406 mm) and minimum 3/8-inch-thick (610 mm) panels for studs spaced 24 inches (9.5 mm) on center. Panels must be exterior-grade or Exposure 1 plywood complying with U.S. Department of Commerce Product Standard PS-1.

3.2.6 Gypsum Board: Water-resistant core-treated gypsum sheathing must comply with ASTM C 79 or ASTM C 1396.

3.2.7 Fiberboard: Minimum 1/2-inch-thick (12.7 mm) asphalt-impregnated fiberboard complying with ASTM C 208 as a regular-density sheathing.

3.2.8 Caulking: Acrylic latex caulking material must comply with ASTM C 834.

3.2.9 Weather Protection:

3.2.9.1 Water-resistive Barrier: The water-resistive barrier must comply with, and be installed in accordance with, IBC Section 1404.2 or IRC Section R703.2, as applicable. Except when installation is over wood-based sheathing, the water-resistive barrier must be either a minimum of one layer of No. 15 asphalt-saturated felt, complying with ASTM D 226, Type I, or a water-resistive barrier recognized as equivalent to ASTM D 226, Type I or better, in a current ICC-ES evaluation report.

When applied over wood-based sheathing, the barrier must be a minimum of two layers of Grade D kraft building paper as set forth in IBC Section 2510.6 and IRC Section R703.6.3, or an equivalent recognized in a current ICC-ES evaluation report.

3.2.9.2 Vapor Retarder: Under the IBC, protection against condensation must be provided in accordance with IBC Section 1403.2. Under the IRC, a vapor retarder complying with IRC Section R318.1 must be provided, unless its omission is permitted under the exceptions to IRC Section R318.1.

3.2.10 Trim and Accessories: All trim, screeds and corner reinforcement must be galvanized steel or approved plastic.

4.0 INSTALLATION

4.1 General:

The water-resistive barrier is applied as set forth in Section 3.2.9. The lath must be applied tightly, with minimum 2-inch (51 mm) end and side laps, and fastened through the water-resistive barrier to wood studs and sills and plates, using fasteners and spacing complying with ASTM C 1063 as referenced in Sections 2510.3 and 2510.4 of the IBC or Sections R703.6, and R703.6.1 of the IRC. Care must be taken to avoid overdriving fasteners. Fasteners for lath must penetrate a minimum of 1 inch (25.4 mm) into wood or steel studs. Flashing, corner reinforcement, and metal trim and weep screeds must be installed as shown in Figure 1. The exterior cementitious coating must be applied by hand-troweling in one coat to a $\frac{3}{4}$ -inch to 1-inch (19.1 mm to 25.4 mm) thickness. Alternatively, the coating may be applied in two coats with the second coat applied as soon as the first coat has attained sufficient rigidity to receive the second coat, in accordance with Section 2512.8 of the IBC. An installation card, as shown in Figure 2, must be completed and signed by the applicator. The coating must be applied at ambient temperatures ranging from 32°F to 110°F (0°C to 43°C) by applicators approved by CTS Cement Manufacturing Company. The lath must be embedded in the minimum coating thickness and be unexposed. The finish coat may be applied after the base coat has cured one hour.

4.2 Application over Open Framing:

The water-resistive barrier must be applied, as set forth in Section 3.2.9.1 of this report, over open wood framing spaced a maximum of 24 inches (610 mm) on center.

The lath must be fastened to wood studs through the water-resistive barrier as set forth in Section 4.1 of this report. Care must be taken to avoid overdriving fasteners.

Wall bracing in accordance with IBC Section 2308.9.3 or IRC Section R602.10, as applicable, or an acceptable alternate, is required. Outside wall corners and parapet corners must be covered with extra metal corner reinforcements attached to the framing members with approved fasteners spaced 18 inches (457 mm) on center, or as necessary to hold plumb. Weep screeds must comply with, and be installed at the bottom of the wall in accordance with, IBC Section 2512.1.2 or IRC Section R703.6.2.1, as applicable. Galvanized steel, $1\frac{3}{8}$ -inch-thick (34.9 mm), No. 22 gage [0.025-inch-thick (0.635 mm)] trim pieces must be installed at other areas where sheathing is exposed. See Figure 1 for typical installation details. At windows and doors, butting J-trim metal edges, when installed, must be caulked. Holes for hose bibbs, electrical panels and other penetrations of substrate surfaces, except those caused by fasteners, must also be caulked. The coating must then be applied as described in Section 4.1.

4.3 Application over Solid Backing:

4.3.1 Fiberboard: Minimum $\frac{1}{2}$ -inch-thick (12.7 mm) fiberboard sheathing must be installed directly over wood studs spaced a maximum of 24 inches (610 mm) on center. The fiberboard must be temporarily held in place with corrosion-resistant staples or roofing nails. A water-resistive barrier, as set forth in Section 3.2.9.1 of this report, must be applied over the fiberboard prior to application of lath. The lath must then be attached to studs through the water-resistive barrier and fiberboard sheathing with the fasteners and spacings described in Section 4.1 of this report or as described for fiberboard in Table 2304.9.1 or Table R602.3 (1) of the IRC, whichever is more restrictive. All walls must be braced in accordance with the applicable code. Exposed sheathing edges must be protected with screeds. Holes in the substrate surface must be caulked and the coating applied as described in Section 4.1 of this report.

4.3.2 Gypsum Sheathing: Minimum $\frac{1}{2}$ -inch-thick (12.7 mm), water-resistant core gypsum sheathing must be installed directly on wood studs spaced at a maximum of 24 inches (610 mm) on center, in a manner similar to the installation for fiberboard. Gypsum sheathing must be fastened in accordance with ASTM C 1280 (under the IBC), or Table R702.3.5 of the IRC. The water-resistive barrier must be installed over the gypsum sheathing prior to installation of the lath and coating as described in Section 4.1 of this report. The sheathing is also permitted to be applied to minimum No. 20 gage [0.035 inch (0.9 mm) minimum base-metal thickness] steel studs spaced at a maximum of 24 inches (610 mm) on center. The gypsum sheathing must be attached to the steel studs with screws complying with ASTM C 954 in accordance with ASTM C 1280 (under the IBC), or Section R702.3.6 of the IRC. The water-resistive barrier must be temporarily fastened, and must be followed by the self-furring or furred lath. The lath must be attached through the water-resistive barrier and gypsum sheathing to steel studs as set forth in Section 4.1 of this report. Screws fastening sheathing and screws fastening lath must be staggered from each other.

4.3.3 Wood-based Structural Panels: Plywood panels must be applied directly to wood studs under the conditions set forth in Section 3.2.5 of this report and either Table 2308.9.3(3) of the IBC or Table R602.3(3) of the IRC, as applicable. The panels must be attached in accordance with Table 2304.9.1 of the IBC or Table R602.3(1) of the IRC, as applicable. The water-resistive barrier, wire-fabric lath and coating must be applied as described for fiberboard in Section 4.3.1.

4.3.4 Concrete or Masonry: The concrete or masonry surface must be prepared according to Section 2510.7 of the IBC. The application of Rapid Set stucco directly to the concrete or masonry without the plaster reinforcement must be in accordance with Section 4.1 of this report.

4.4 Fire-resistance-rated construction:

Rapid Set Stucco may be used in fire-resistance-rated construction described in Table 720.1 (2) of the IBC, replacing the cement plaster identified in Items 15-1.2, 15-1.3, 15-1.4, 15-1.7, and 15-1.8.

4.5 Miscellaneous:

4.5.1 Inspection Requirements: Building department inspection is required on lath installation prior to application of the coating as noted in IBC Section 109.3.5 for jurisdictions adopting the IBC or IRC.

4.5.2 Control Joints: Control joints must be installed as specified by the architect, designer, builder or exterior coating manufacturer, in that order. In the absence of details, conventional three-coat plastering details must be used.

4.5.3 Curing: Moist curing must be provided for one hour after application by misting or light spraying, before application of the finish coat.

4.5.4 Soffits: The system may be applied to soffits, provided the coating is applied over metal lath complying with Section 3.2.4 of this report in lieu of wire fabric lath. Expanded metal lath fastening must comply with IBC Section 2510.3 or IRC Section R703.6.1, as applicable, except that the fastener length must be increased by the thickness of any substrate.

4.5.5 Sills: The system may be applied to sills at locations such as windows and similar areas. Sills with depths of 6 inches (152 mm) or less may have the coating and lath applied to any substrate permitted in this report, provided the coating, lath, water-resistant barrier and substrate are installed in accordance with the applicable sections of this report. Sills with depths exceeding 6 inches (152 mm) must have substrates of solid wood or plywood. The substrate must be fastened in accordance with IBC Table 2304.9.1 or IRC Section R602.3, as applicable, and a double layer of Grade D water-resistive barrier must be applied over the substrate. The lath and coating must be applied in accordance with Section 4.1 of this report.

5.0 CONDITIONS OF USE

The Rapid Set One Coat Stucco System described in this report complies with, or is a suitable alternative to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1** The materials and methods of installation must comply with this report and the manufacturer's published installation instructions. In the event of a conflict between this report and the manufacturer's published installation instructions, this report governs.
- 5.2** Installation must be by applicators approved by the manufacturer.
- 5.3** The system must be limited to Type V construction or construction permitted by the IRC, when applied over wood framing.
- 5.4** When the system is applied to noncombustible concrete or masonry surfaces, the walls retain the noncombustible rating.
- 5.5** The system must be limited to non-fire-resistance-rated construction except as described in Section 4.4 of this report.
- 5.6** An installation card, as shown in Figure 2, must be left at the jobsite for the owner, and a copy must be filed with the building department.
- 5.7** When foam plastic plant-ons are used, the interior of the building must be separated from the foam plastic plant-on with a thermal barrier complying with the applicable code, such as 1/2-inch-thick (12.7 mm) regular gypsum wallboard mechanically attached in accordance with the applicable code.

6.0 EVIDENCE SUBMITTED

Data in accordance with applicable portions of the ICC-ES Acceptance Criteria for Cementitious Exterior Wall Coatings (AC11), dated June 2007 (editorially revised April 2008).

7.0 IDENTIFICATION

The Eisenwall cement and Rapid Set Stucco factory-prepared mixes are delivered to the jobsite in water-resistant bags with labels bearing the following information:

1. Name and address of the manufacturer, and the evaluation report number (ESR-2671).
2. Product designation.
3. Weight of packaged mix.
4. Storage instructions.
5. Curing instructions.

8.0 Other Codes:

8.1 Evaluation Scope:

The system described in Sections 2.0 through 7.0 was also evaluated for compliance with the 1997 *Uniform Building Code*TM (UBC).

8.2 Uses:

See Section 2.0.

8.3 Description:

See Section 3.0, except for the following modifications to the indicated report sections::


- **3.2.2 Rapid Set Eisenwall Cement:** The Rapid Set Eisenwall Cement is a plastic cement complying with UBC Standard 25-1 and packaged in 88-pound (40 kg) bags.
- **3.2.4 Lath:** Metal lath must comply with UBC Table 25-B.
- **3.2.7 Fiberboard:** Minimum 1/2-inch-thick (12.7 mm) asphalt-impregnated fiberboard complying with ANSI/AHA194.1 as a regular-density sheathing.
- **3.2.9.1. Weather-resistive Barrier:** Application of the barrier must comply with UBC Section 1402.1. Except when installation is over wood-based sheathing, the weather-resistive barrier must be minimum Grade D kraft building paper complying with UBC Standard 14-1, or must be a weather-resistive barrier recognized as equivalent to Grade D or better in a current ICC-ES evaluation report. When applied over any wood-based sheathing, the barrier must be a minimum of two layers of Grade D kraft building paper complying with UBC Standard 14-1 as set forth in UBC Section 2506.4; or an equivalent recognized in a current ICC-ES evaluation report.

8.4 Installation:


See Section 4.0, with the following modifications to the indicated report sections:

- **4.1 General:** The exterior cementitious coating is applied by hand troweling in one coat to a 3/4-inch to 1-inch (19.1 mm to 25.4 mm) thickness. Alternatively, the coating may be applied in two coats with the second coat applied as soon as the first coat has attained sufficient rigidity to receive the second coat, in accordance with Section 2508.6 of the UBC
- **4.2 Application over Open Framing:** Wall bracing in accordance with UBC Sections 2320.11.3 and 2320.11.4, or an acceptable alternate, is required. Weep screeds must comply with, and be installed at the bottom of the wall in accordance with, UBC Section 2506.5.
- **4.3.1 Fiberboard:** The metal lath shall be attached to studs through the sheathing with fasteners and spacings as described for insulation board in Section 4.1.2 of this report or as described for fiberboard in Table 23-II-B-1 of the UBC.
- **4.3.2 Gypsum Sheathing:** Gypsum sheathing must be fastened to the wood or steel studs in accordance with Table 25-G of the UBC.


- **4.3.3 Wood Structural Panel Sheathing:** Wood structural panel sheathing is applied directly to wood studs under conditions as set forth in Section 3.2.5 of this report and UBC Table 23-IV-D-1.
 - **4.3.4 Concrete or Masonry:** The concrete or masonry surface is prepared in accordance with Section 2508.8 of the UBC. The application of Rapid Set Stucco is in accordance to Table 25-D of the UBC and Section 2.3.1 of this report.
 - **4.4 Fire-resistance-rated Construction:** Rapid Set Stucco may be used in fire-resistive assemblies as described in Table 7-B of the UBC, replacing the cement plaster identified in Items 18-1.2, 18-1.3, 18-1.4, 18-1.7, and 18-1.8.
 - **4.5.1 Inspection Requirements:** Building department inspection is required on lath installation prior to application of the coating, as noted in UBC Section 108.5.5.
 - **4.5.4 Soffits:** Expanded metal lath fastening must comply with UBC Table 25-C, except that the fastener length must be increased by the thickness of any substrate.
 - **4.5.5 Sills:** Sill depths exceeding 6 inches must have substrates of solid wood or plywood. The substrate is fastened in accordance with Table 23-II-B-1 of the UBC, with a double layer of a complying weather-resistive barrier applied over the substrate.
- 8.5 Conditions of Use:**
See Section 5.0.
- 8.6 Evidence Submitted:**
See Section 6.0, with the addition of the following: Reports of tests in accordance with UBC Standard 25-1.

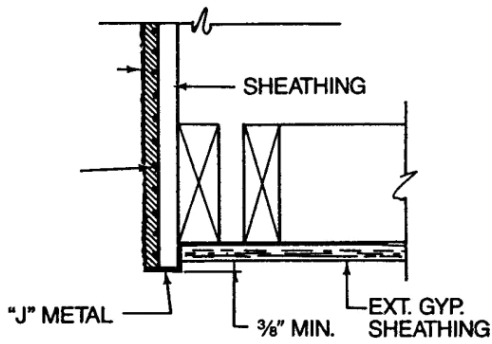


WOOD SOFFIT DETAIL

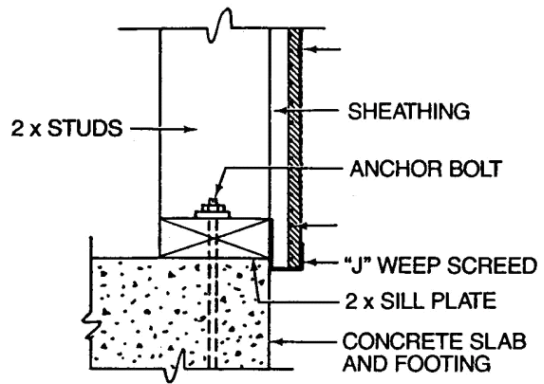

SILL FLASHING

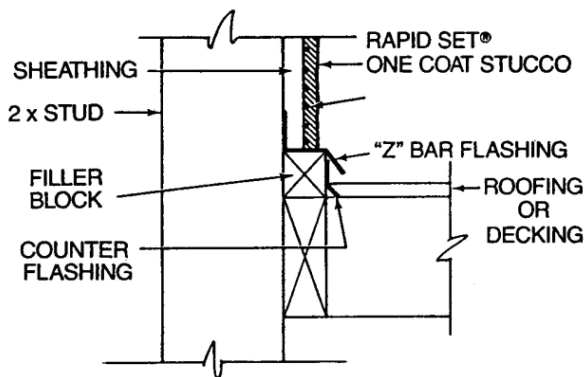


GABLE OR DECK FLASHING

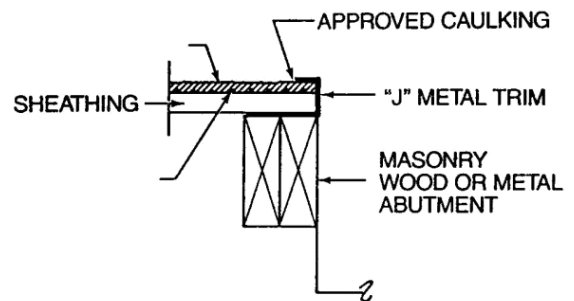


PLASTER GROUND

NOTE: WHEN PROPER PLASTER GROUND OR NAIL-ON FLANGE ARE NOT PROVIDED USE PLASTER GROUND DETAIL.

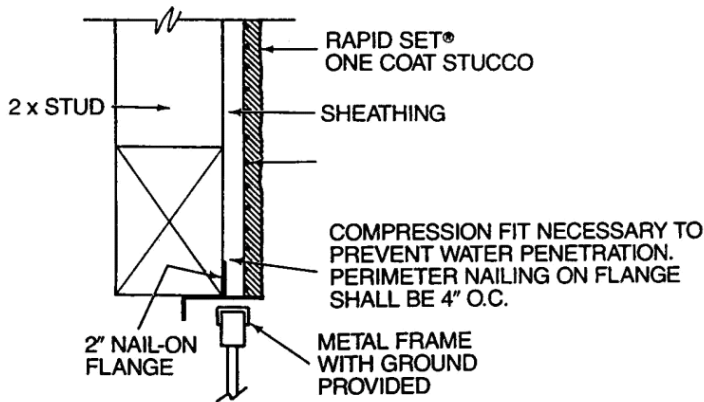


COMPRESSION FIT-METAL FRAME

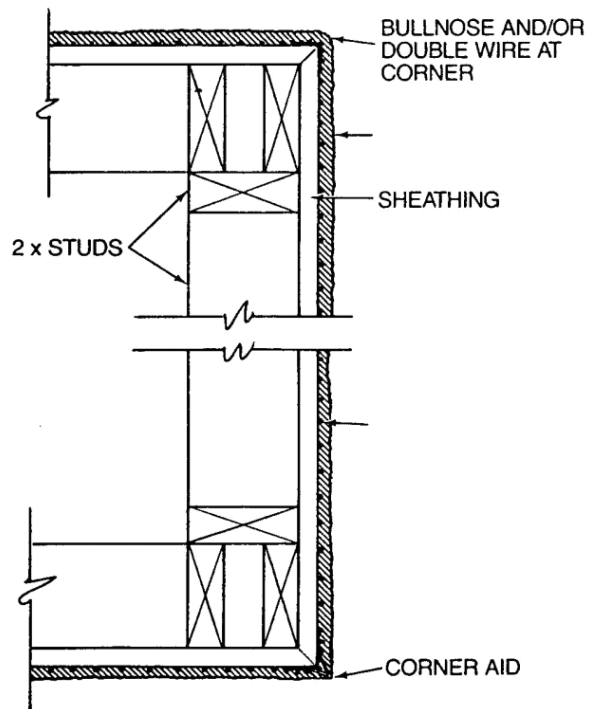


SQUARE CORNER-BULLNOSE CORNER

FIGURE 1


NOTE: PARAPET CAP SHOULD BE BULLNOSED OR SLOPED. FOAM SHEATHING ON TOP AND ROOFSIDE OF PARAPET OPTIONAL. WHEN FOAM IS OMITTED USE APPROVED SOLID BACKING.

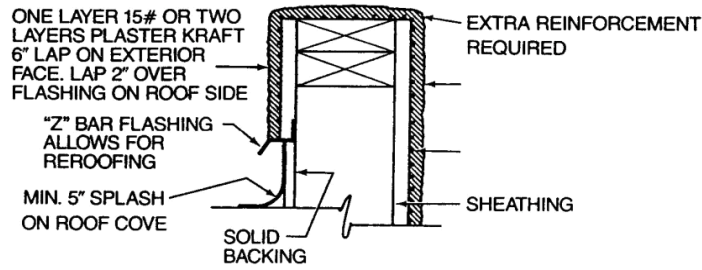

PARAPET AND FLASHING DETAIL

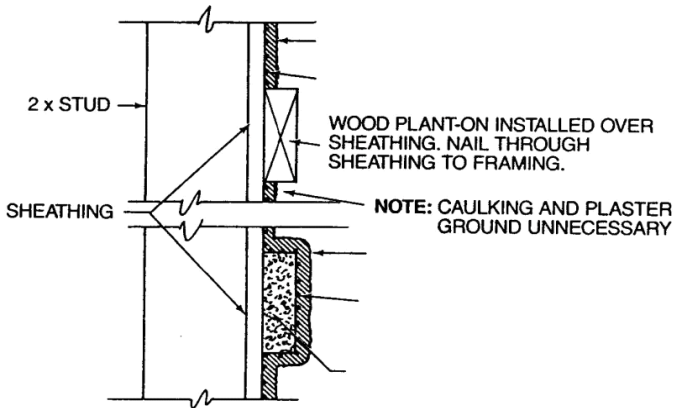

PLANT-ON

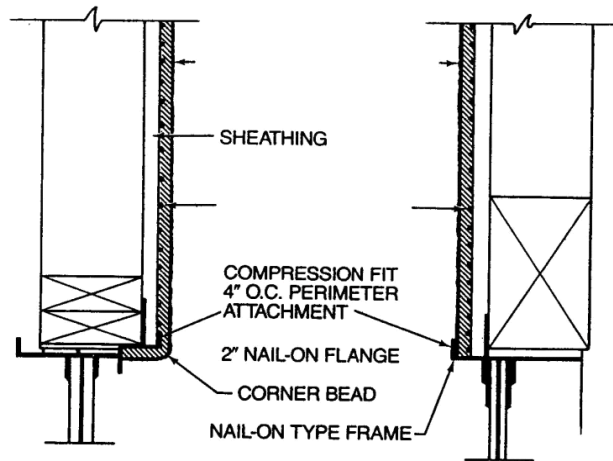

SLIDING DOOR

For SI: 1 inch = 25.4 mm.

FIGURE 1 (Continued)

INSTALLATION CARD
RAPID SET ONE COAT STUCCO SYSTEM
CTS CEMENT MANUFACTURING COMPANY

Job Address

ICC Evaluation Service, Inc.

ESR-2671

Date of Job Completion:

Plastering Contractor

Name:

Address:

Telephone No. ()

Approved contractor number as issued
by the coating manufacturer

This is to certify that the exterior coating system on the building exterior at the above address has been installed in accordance with the evaluation report specified above and the manufacturer's instructions.

Signature of authorized representative
of plastering contractor

Date

This installation card must be presented to the building inspector after completion of work and before final inspection.

FIGURE 2